

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-17/0991
of 10 September 2019

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

ejothem S1

Product family
to which the construction product belongs

Screwed-in plastic anchor for fixing of external thermal
insulation composite systems with rendering in concrete
and masonry

Manufacturer

EJOT Baubefestigungen GmbH
In der Stockwiese 35
57334 Bad Laasphe
DEUTSCHLAND

Manufacturing plant

manufacturing plant EJOT 1, 2, 3 and 4

This European Technical Assessment
contains

15 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330196-01-0604

This version replaces

ETA-17/0991 issued on 18 July 2018

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The screwed-in anchor ejotherm S1 consists of an anchor sleeve made of polyethylene (virgin material), an anchor plate made of polyethylene (virgin material) and an accompanying specific screw made of polyamide (virgin material).

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Characteristic tension resistance	See Annex C 1
Edge distances and spacing	See Annex B 2
Plate stiffness	See Annex C 2
Displacements	See Annex C 2

3.2 Energy economy and heat retention (BWR 6)

Essential characteristic	Performance
Point thermal transmittance	See Annex C 2

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with EAD No. 330196-01-0604, the applicable European legal act is: [97/463/EC].

The system to be applied is: 2+


5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 10 September 2019 by Deutsches Institut für Bautechnik

Dr.-Ing. Lars Eckfeldt
p. p. Head of Department

beglaubigt:
Ziegler

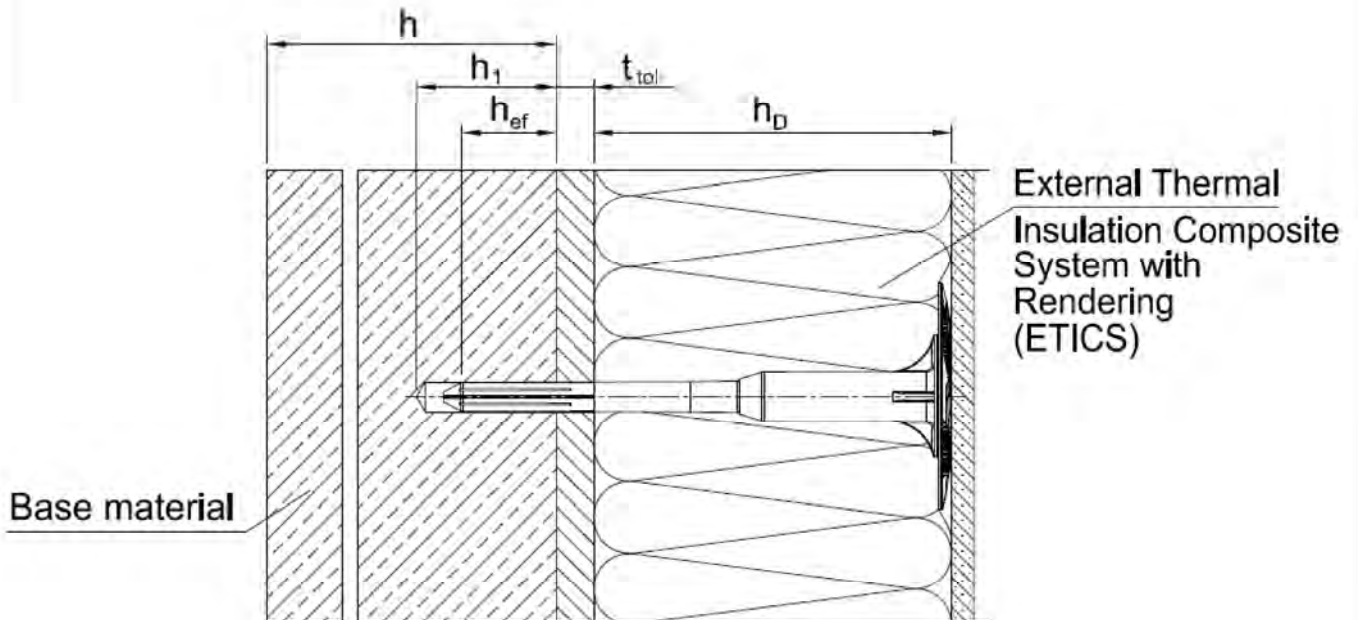

Intended use

- Anchorage of ETICS in concrete and masonry
- Anchorage of ETICS in autoclaved aerated concrete and lightweight aggregate concrete

Legend:


- h_D = thickness of insulation material
- h_{ef} = effective anchorage depth
- h = thickness of member (wall)
- h_1 = depth of drilled hole to deepest point
- t_{tol} = thickness of equalizing layer or non-load-bearing coating

ejotherm S1

Product description
Installed condition ejotherm S1

Annex A 1

ejotherm S1 in use category A, B, C, D

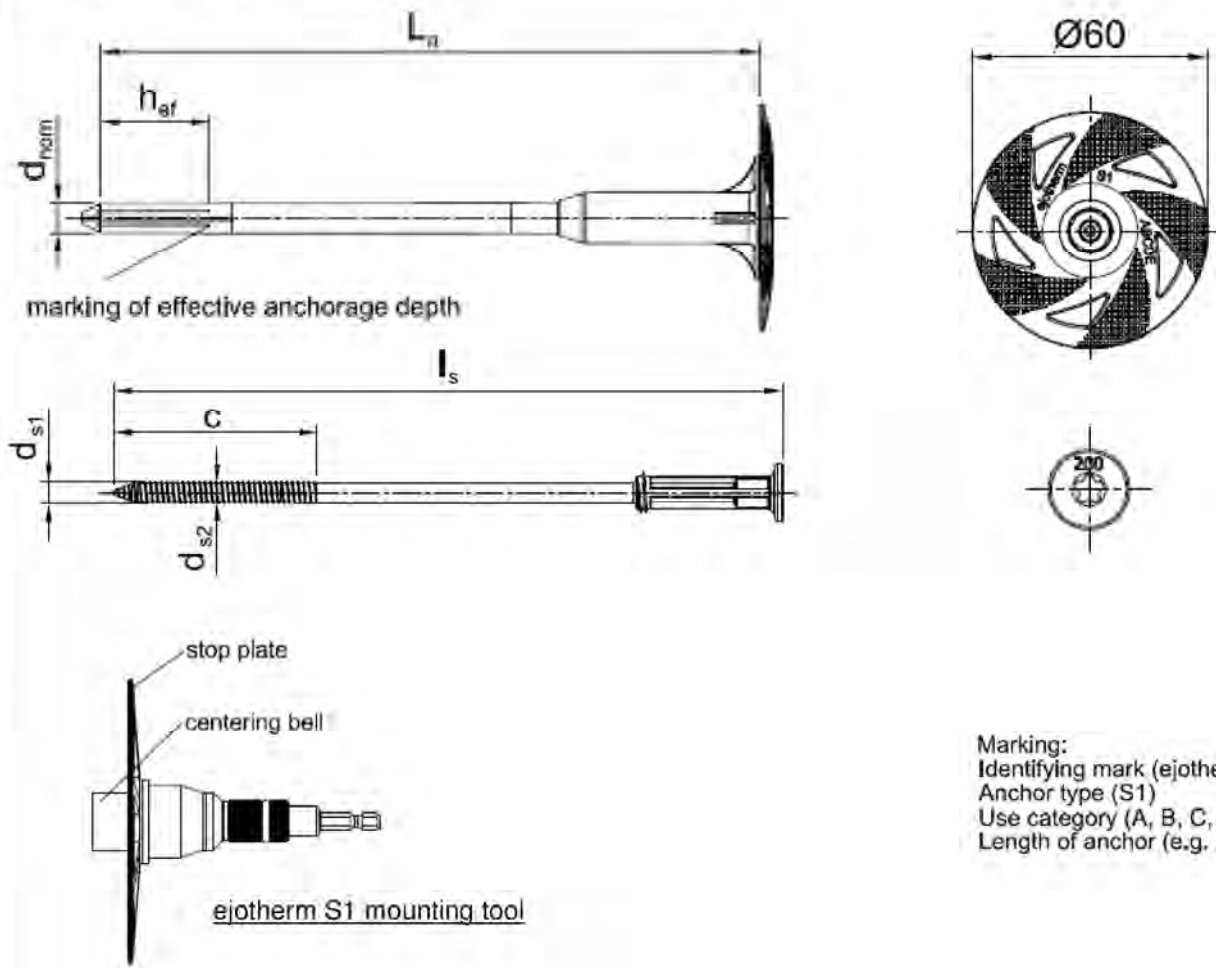

Marking:
Identifying mark (ejotherm)
Anchor type (S1)
Use category (A, B, C, D, E)
Length of anchor (e.g. 200)

Table A1: Dimensions

Anchor Type	Anchor Sleeve			Plastic screw			
	d_{nom} [mm]	h_{ef} [mm]	min L_a max L_a [mm]	d_{s1} [mm]	d_{s2} [mm]	c [mm]	min l_s max l_s [mm]
ejotherm S1	8	30	100 300	5,7	5,0	55	100 300

Determination of maximum thickness of insulation h_D [mm] ejotherm S1:

$$h_D = L_a - t_{tol} - h_{ef}$$

e.g. $h_D = 200 - 10 - 30$
 $h_{Dmax} = 160$


ejotherm S1

Product description

Marking and dimension of the anchor sleeve; use category: A, B, C, D
Plastic screw

Annex A 2

ejotherm S1 in use category A, B, C, D – large version

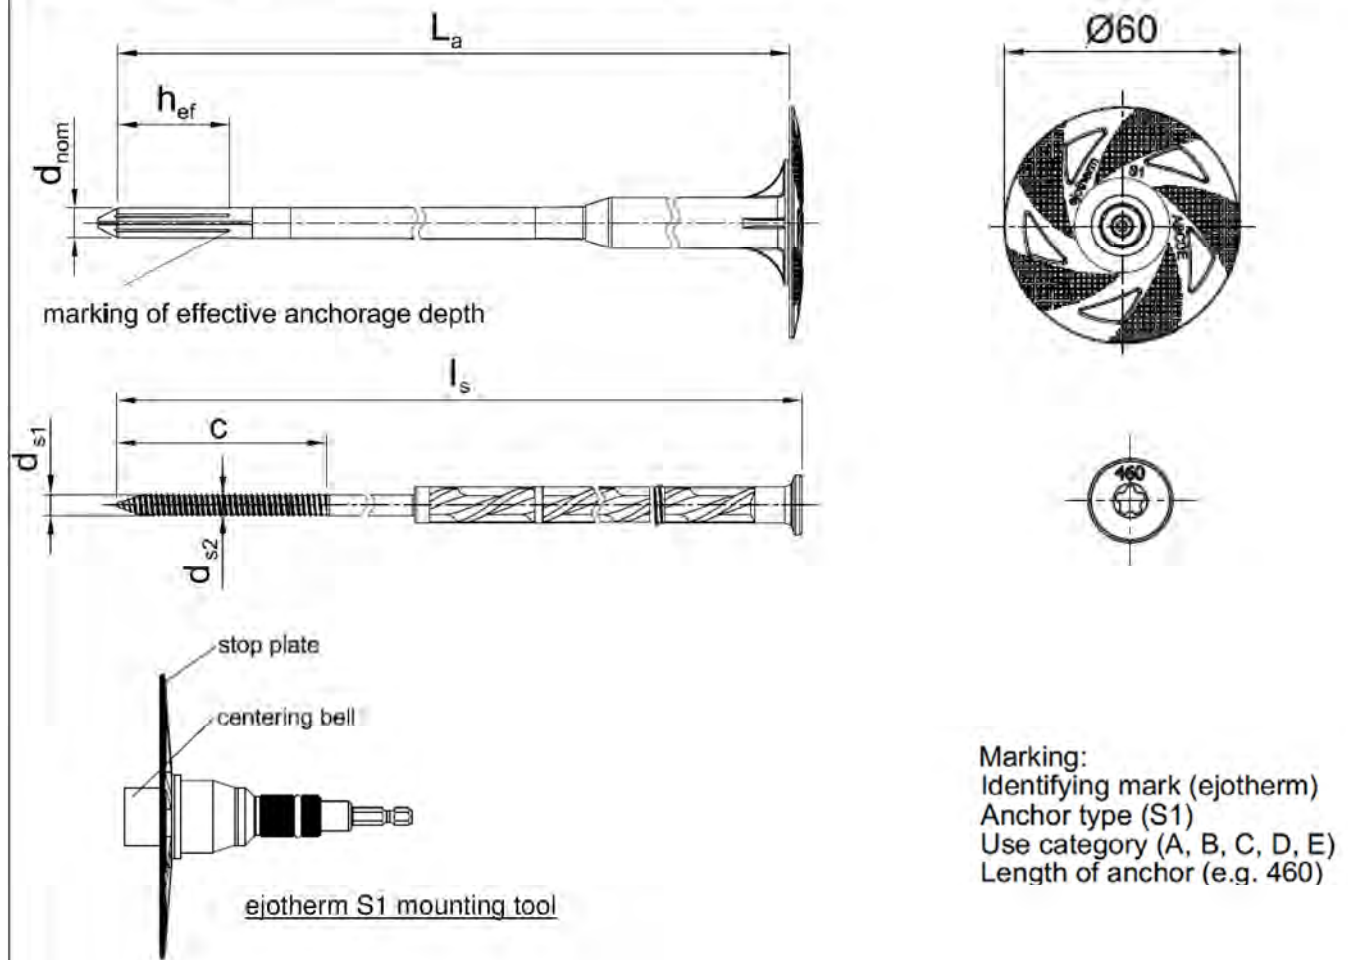

Marking:
Identifying mark (ejotherm)
Anchor type (S1)
Use category (A, B, C, D, E)
Length of anchor (e.g. 460)

Table A2: Dimensions

Anchor Type	Anchor Sleeve			Plastic screw			
	d_{nom} [mm]	h_{ef} [mm]	min L_a max L_a [mm]	d_{s1} [mm]	d_{s2} [mm]	c [mm]	min l_s max l_s [mm]
ejotherm S1	8	30	320 460	5,7	5,0	55	320 460

Determination of maximum thickness of insulation h_D [mm] ejotherm S1:

$$h_D = L_a - t_{tol} - h_{ef}$$

e.g. $h_D = 460 - 10 - 30$
 $h_{Dmax} = 420$


ejotherm S1

Product description

Marking and dimension of the anchor sleeve – large version; use category: A, B, C, D
Plastic screw

Annex A 3

ejotherm S1 in use category E

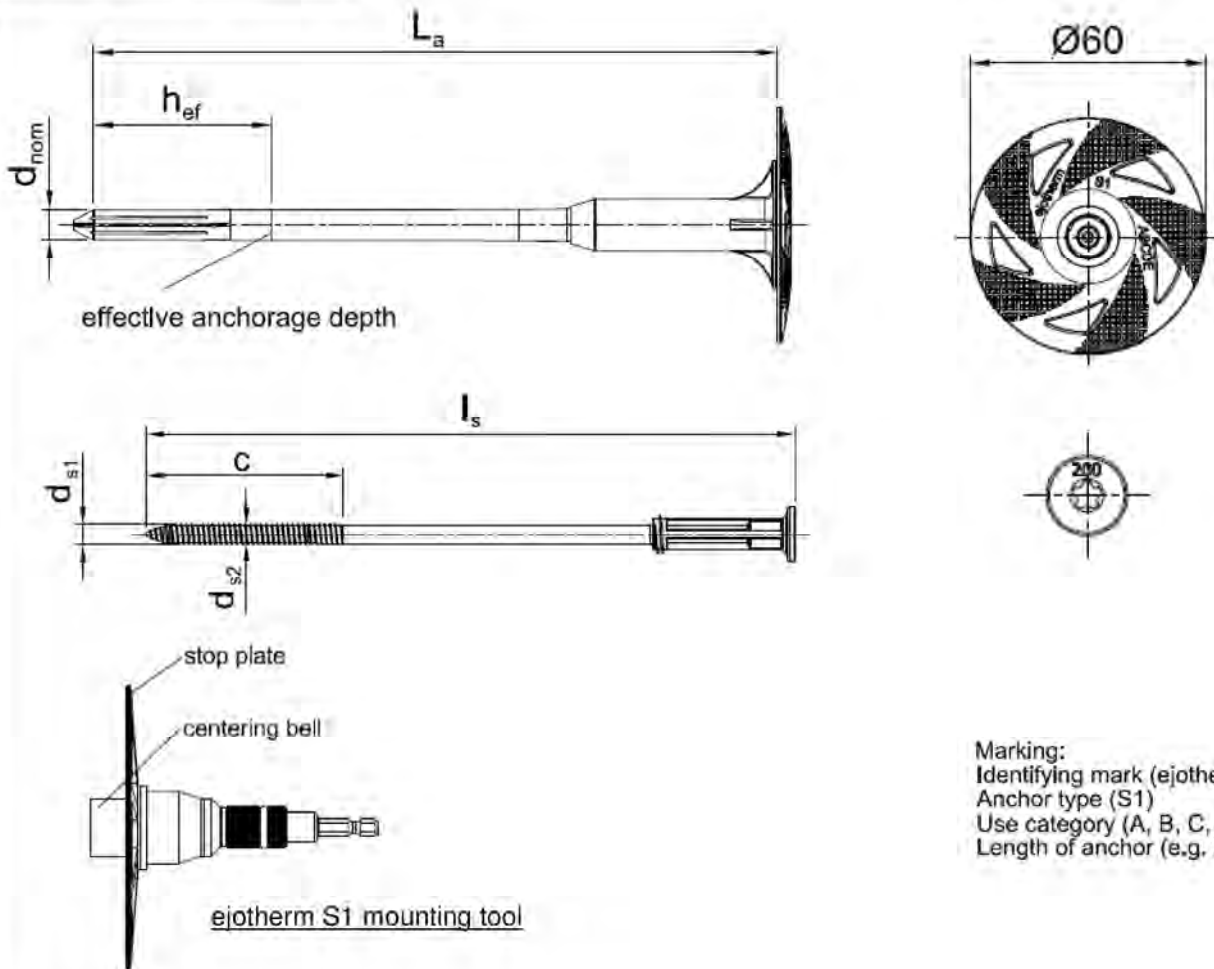

Marking:
Identifying mark (ejotherm)
Anchor type (S1)
Use category (A, B, C, D, E)
Length of anchor (e.g. 200)

Table A3: Dimensions

Anchor Type	Anchor Sleeve			Plastic screw			
	d_{nom} [mm]	h_{ef} [mm]	min L_a max L_a [mm]	d_{s1} [mm]	d_{s2} [mm]	c [mm]	min l_s max l_s [mm]
ejotherm S1	8	50	100 300	5,7	5,0	55	100 300

Determination of maximum thickness of insulation h_D [mm] ejotherm S1:

$$h_D = L_a - t_{tol} - h_{ef}$$

e.g. $h_D = 200 - 10 - 50$
 $h_{Dmax} = 140$

ejotherm S1

Product description

Marking and dimension of the anchor sleeve; use category: E
Plastic screw

Annex A 4

eiotherm S1 in use category E – large version

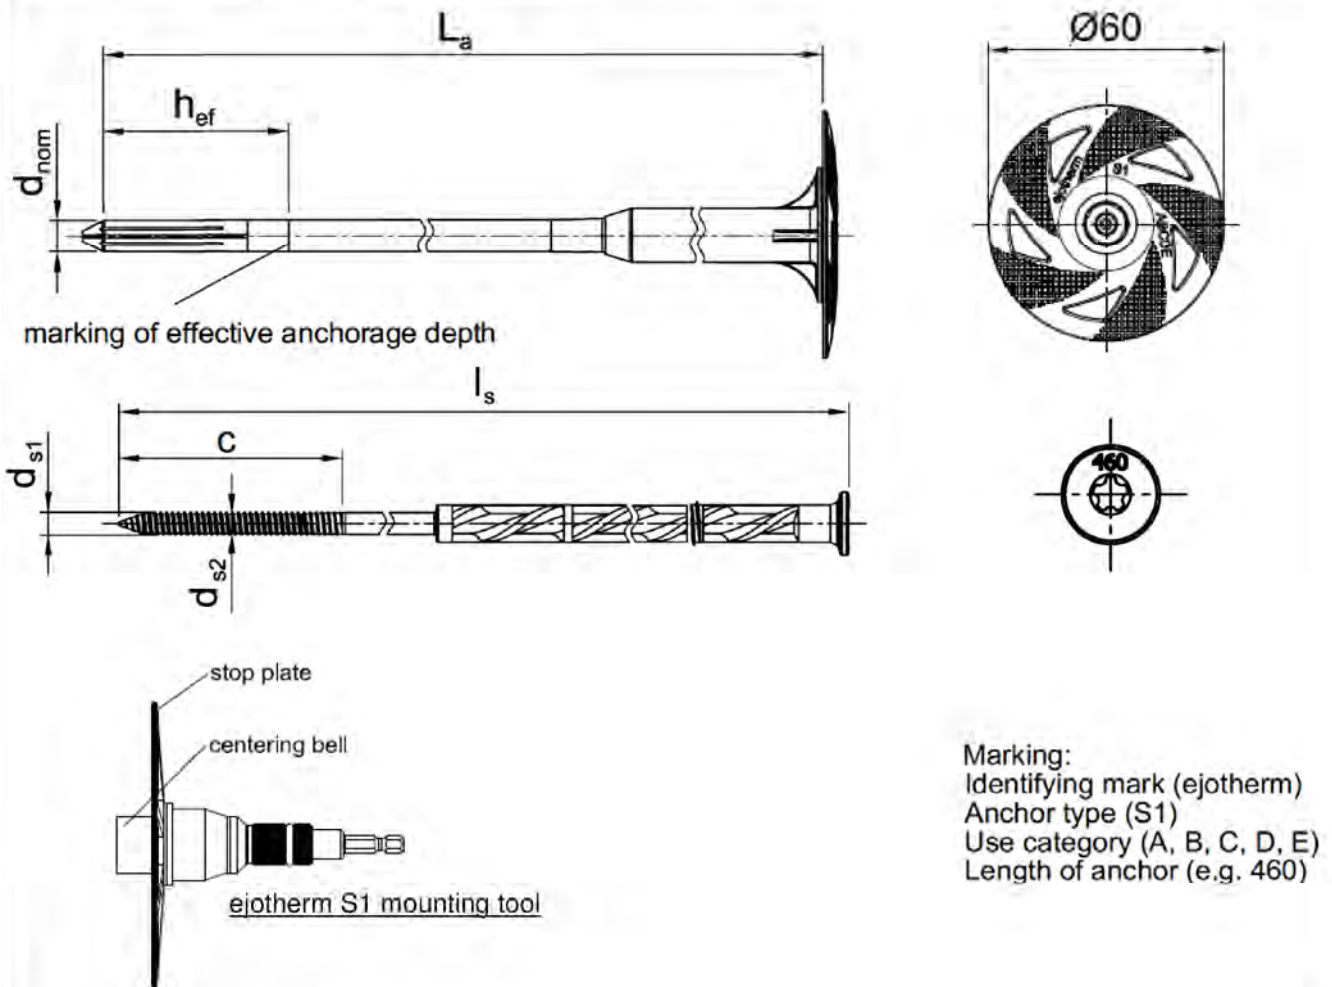


Table A4: Dimensions

Anchor Type	Anchor Sleeve			Plastic screw			
	d_{nom} [mm]	h_{ef} [mm]	min L_a max L_a [mm]	d_{s1} [mm]	d_{s2} [mm]	c [mm]	min l_s max l_s [mm]
eiotherm S1	8	50	320 460	5,7	5,0	55	320 460

Determination of maximum thickness of insulation h_D [mm] eiotherm S1:

$$h_D = L_a - t_{tol} - h_{ef}$$

e.g. $h_D = 460 - 10 - 50$
 $h_{Dmax} = 400$

eiotherm S1

Product description



Marking and dimension of the anchor sleeve – large version; use category: E
Plastic screw

Annex A 5

Table A5: Materials ejotherm S1



Designation	Material
Anchor plate	Polyethylene (virgin material) PE-HD, nature, yellow, orange, red, blue, grey, white, nature, green, anthracite
Anchor sleeve	Polyethylene (virgin material) PE-HD, nature, yellow, orange, red, blue, grey, white, nature, green, anthracite
Plastic screw	Polyamide (virgin material) PA 6 GF 50, nature, black

SBL 140 plus

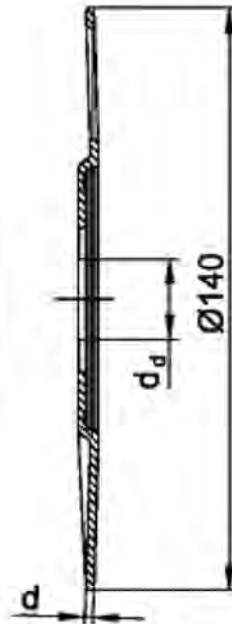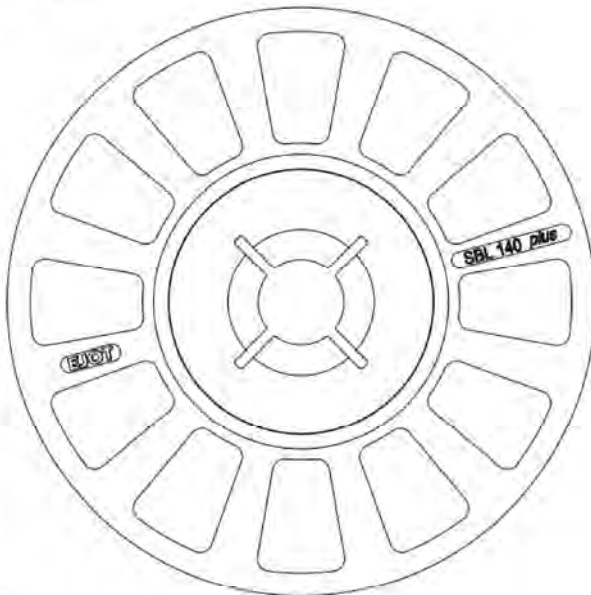

SBL 140 plus	
colour	nature
d_d [mm]	20,0
d [mm]	2,0
material	^{1) 2)}

VT 90

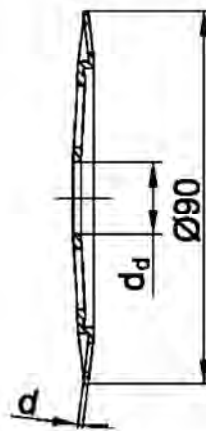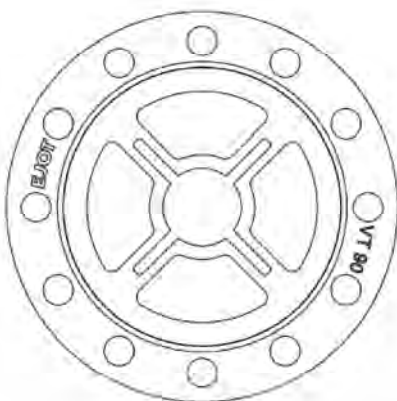

VT 90	
colour	nature
d_d [mm]	17,5
d [mm]	1,2
material	^{1) 2)}

¹⁾ polyamide, PA 6
²⁾ polyamide, PA GF 50

ejotherm S1

Product description
Materials of ejotherm S1 and slip on plates

Annex A 6

Specifications of intended use

Anchorage subject to:

- The anchor may only be used for transmission of wind suction loads and shall not be used for the transmission of dead loads of the thermal insulation composite system.

Base materials:

- Normal weight concrete (use category A) according to Annex C1.
- Solid masonry (use category B), according to Annex C1.
- Hollow or perforated masonry (use category C), according to Annex C1.
- Prefabricated reinforced components of lightweight aggregate concrete (LAC) (use category D), according to Annex C1.
- Autoclaved aerated Concrete (use category E), according to Annex C1.
- For other base materials of the use categories A, B, C, D or E the characteristic resistance of the anchor may be determined by job site tests according to EOTA Technical Report TR 51 edition December 2016.

Temperature Range:

- 0°C to +40°C (max. short term temperature +40°C and max. long term temperature +24°C)

Design:

- The anchorages are designed under the responsibility of an engineer experienced in accordance and masonry work with the partial safety factors $\gamma_m = 2,0$ and $\gamma_F = 1,5$ if there are no other regulations.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings.
- Fasteners are only to be used for multiple fixings of thermal insulation composite systems.

Installation:

- Hole drilling by the drill modes according to Annex C1.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Installation temperature from 0°C to +40°C
- Exposure to UV due to solar radiation of the anchor not protected by rendering ≤ 6 weeks

ejotherm S1	Annex B 1
Intended use Specifications	


Table B1: Installation parameters

Anchor type		ejothem S1	
		use category	
		A, B, C, D	E
Drill hole diameter	d_0 [mm] =	8	8
Cutting diameter of drill bit	d_{cut} [mm] ≤	8,45	8,45
Depth of drilled hole to deepest point	h_1 [mm] ≥	40	60
Effective anchorage depth	h_{ef} [mm] ≥	30	50

Table B2: Anchor distances and dimensions of members

Anchor type		ejothem S1	
Minimum spacing	$s_{min} \geq$ [mm]	100	
Minimum edge distance	$c_{min} \geq$ [mm]	100	
Minimum thickness of member	$h \geq$ [mm]	100	

Scheme of distance and spacing

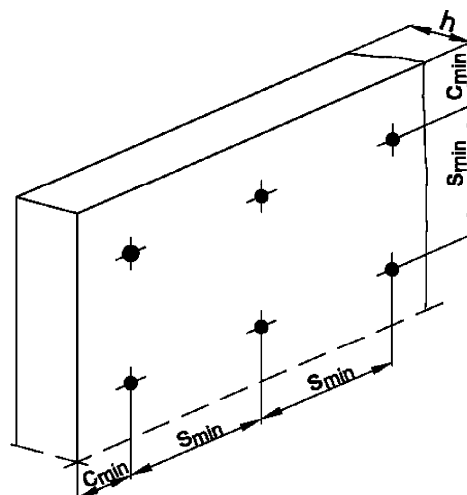


ejothem S1

Intended use
Installations parameters,
Edge distances and spacing

Annex B 2

Installation instructions

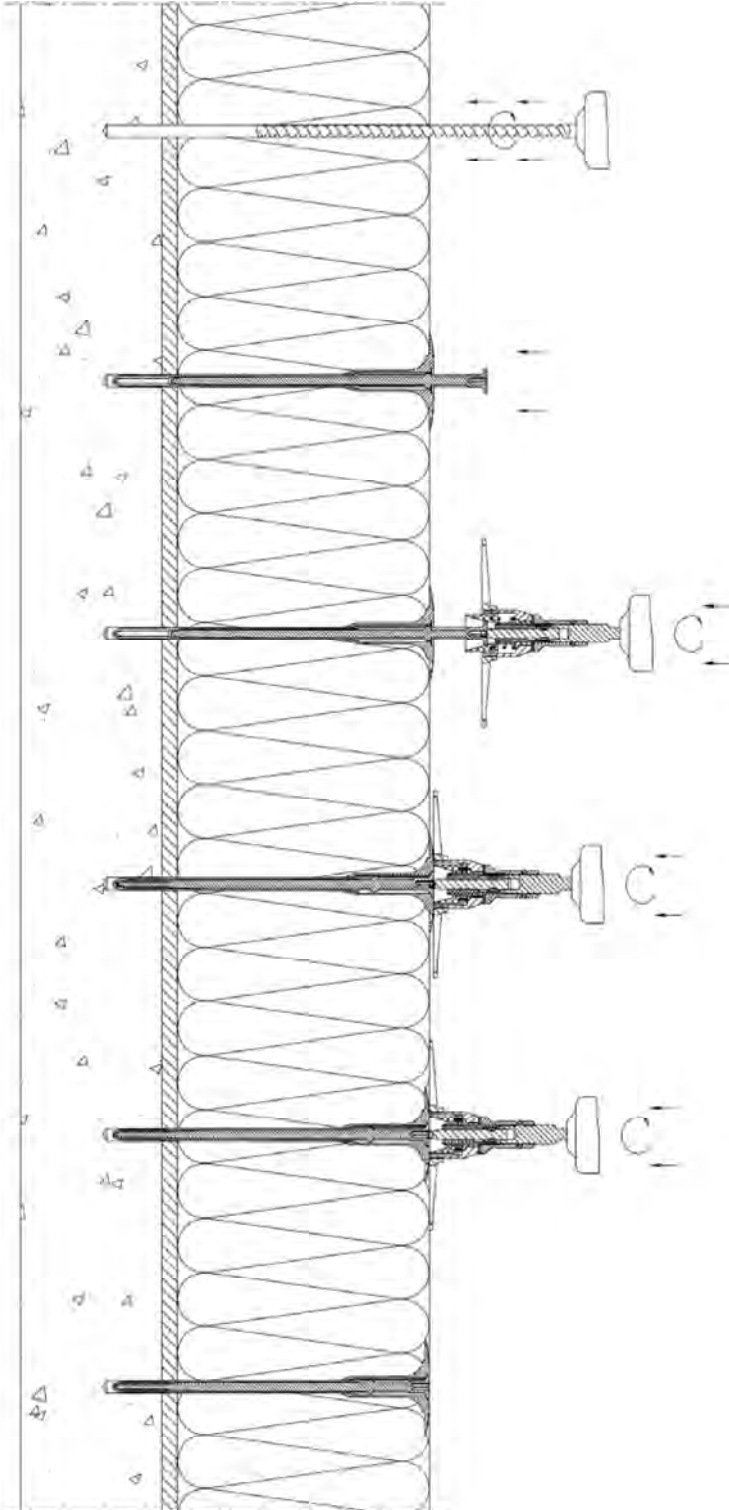

Drill the hole perpendicular to the substrate surface.
Clean the drill hole 3x.

Place the anchor into the drill hole.
The bottom side of the plate must be flush with the insulation.

Placing the mounting tool on the dowel screw

Mounting the screw

Top side of the anchor plate mounted flush with the insulation board surface. Assembly tool decoupled.

Installed conditions ejothem S1

ejothem S1

Intended use
Installation instructions

Annex B 3

Table C1: Characteristic resistance to tension loads N_{Rk} in concrete and masonry for a single anchor in kN					
Anchor type					ejothem S1
Base materials	Bulk density class ρ [kg/dm ³]	minimum compressive strength f_b [N/mm ²]	General remarks	Drill method	N_{Rk} [kN]
Concrete C12/15 – C50/60 EN 206-1:2000				hammer	1,5
Thin concrete members (e.g. weather resistant skin) Concrete C16/20 – C50/60 EN 206-1:2000			Thickness of the thin skin: 100 mm > h ≥ 40 mm	hammer	1,4
Clay bricks, Mz EN 771-1:2011	≥ 1,8	12	Vertically perforation up to 15 %.	hammer	1,5
Sand-lime solid bricks, KS EN 771-2:2011	≥ 1,8	12	Vertically perforation up to 15 %.	hammer	1,5
Vertically perforated clay bricks, HLz EN 771-1:2011	≥ 1,6	20	Vertically perforation > 15 % and ≤ 50 %.	hammer	1,5 ¹⁾
Sand-lime perforated bricks, KSL EN 771-2:2011	≥ 1,6	12	Vertically perforation > 15 % and ≤ 50 %.	hammer	1,5 ²⁾
Lightweight concrete hollow blocks, Hbl EN 771-3:2011	≥ 1,2	7		hammer	0,9 ³⁾
lightweight aggregate concrete LAC 4 – LAC 25 EN 1520:2011 / EN 771-3:2011	≥ 0,7	7		rotary	0,9
Autoclaved aerated concrete AAC 4 – AAC 7 EN 771-4:2011	≥ 0,55	6		rotary	0,75
ejothem S1					Annex C 1
Performances Characteristic resistance					

¹⁾ The value applies only for outer web thickness ≥ 25 mm; otherwise the characteristic resistance shall be determined by job site pull-out tests.

²⁾ The value applies only for outer web thickness ≥ 20 mm; otherwise the characteristic resistance shall be determined by job site pull-out tests.

³⁾ The value applies only for outer web thickness ≥ 40 mm; otherwise the characteristic resistance shall be determined by job site pull-out tests.

Table C2: Point thermal transmittance according EOTA Technical Report TR 025:2016-05

anchor type	insulation thickness h_D [mm]	point thermal transmittance χ [W/K]
ejothem S1	80 – 460	0

Table C3: Plate stiffness according EOTA Technical Report TR 026:2016-05

anchor type	diameter of the anchor plate [mm]	load resistance of the anchor plate [mm]	plate stiffness [kN/mm]
ejothem S1	60	1,5	0,7

Table C4: Displacements

Base materials	Bulk density class ρ [kg/dm ³]	minimum compressive strength f_b [N/mm ²]	Tension load N [kN]	Displacements $\delta(N)$ [mm]	
				$L_a =$ 100 - 300 mm	$L_a =$ 320 - 460 mm
Concrete C12/15 – C50/60 EN 206-1:2000			0,5	0,6	0,9
Thin concrete members (e.g. weather resistant skin) Concrete C16/20 – C50/60 EN 206-1:2000			0,45	0,6	0,9
Clay bricks, Mz EN 771-1:2011	$\geq 1,8$	12	0,5	0,6	0,9
Sand-lime solid bricks, KS EN 771-2:2011	$\geq 1,8$	12	0,5	0,6	0,9
Vertically perforated clay bricks, HLz EN 771-1:2011	$\geq 1,6$	20	0,5	0,6	0,9
Sand-lime perforated bricks, KSL EN 771-2:2011	$\geq 1,6$	12	0,5	0,6	0,9
Lightweight concrete hollow blocks, Hbl EN 771-3:2011	$\geq 1,2$	7	0,3	0,4	0,6
lightweight aggregate concrete LAC 4 – LAC 25 EN 1520:2011 / EN 771-3:2011	$\geq 0,7$	7	0,3	0,4	0,6
Autoclaved aerated concrete AAC 4 – AAC 7 EN 771-4:2011	$\geq 0,55$	6	0,25	0,3	0,4

ejothem S1

Performances

Point thermal transmittance, plate stiffness, displacements

Annex C 2